

SNAP HOOKS & WEBBING  
@ 12 O'CLOCK ON 24" SPACING

TURNBUCKLE,  
THIMBLE AND  
CABLE CLAMPS

5' FROM WALL

TOP OF RAISED FLOOR

3/16" CABLE

2-1/4"

12" DUCT  
DIAMETER

2'-0"

ZIPPERED  
CONNECTION

WALL MOUNT  
BY OTHERS

FLOOR  
PEDESTAL

CONTINUOUS  
LINEAR VENTS @  
3 & 9 O'CLOCK

PEDESTAL TO PEDESTAL SUPPORT  
CABLES 15' CTR TO CTR TO  
PREVENT 3/16" CABLES  
FROM SAGGING SUPPLIED BY INSTALLER

FABRIC DUCT


TOP OF FOUNDATION SLAB

SEE DRAWING FOR  
CABLE TERMINATION  
TO PEDESTAL SYSTEM


WEBBED ANCHOR BELT  
AND RATCHET

METAL SUPPLY  
DUCT

# UNDERFLOOR FABRIC DUCT-SINGLE CABLE/SNAP HOOK MOUNTING NO SCALE

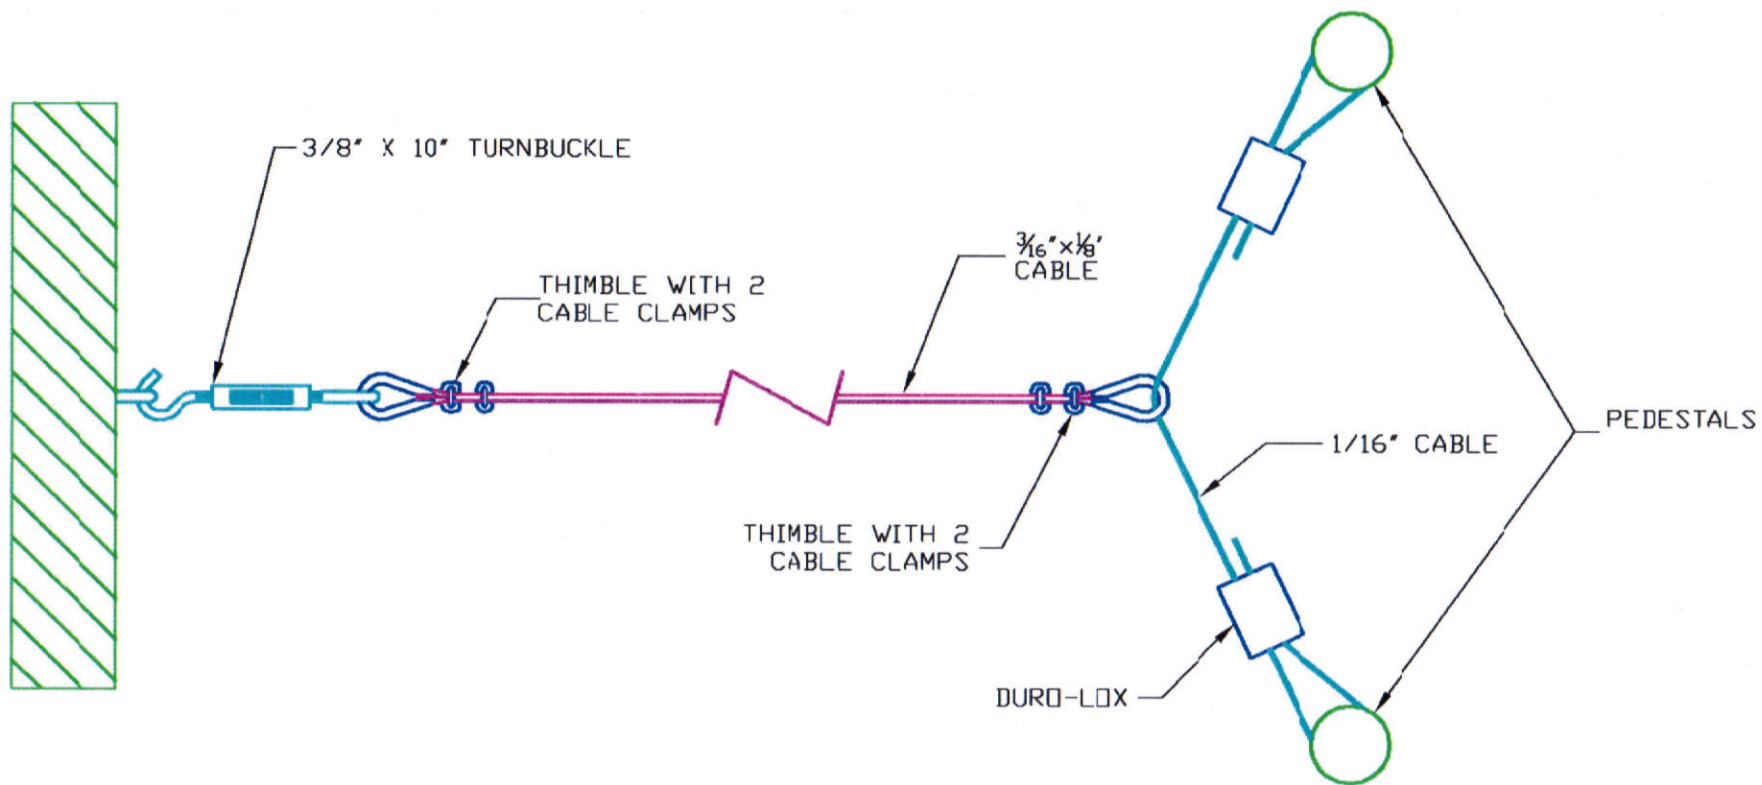

STANDARD SINGLE CABLE/UNDER FLOOR MOUNTING  
NO SCALE

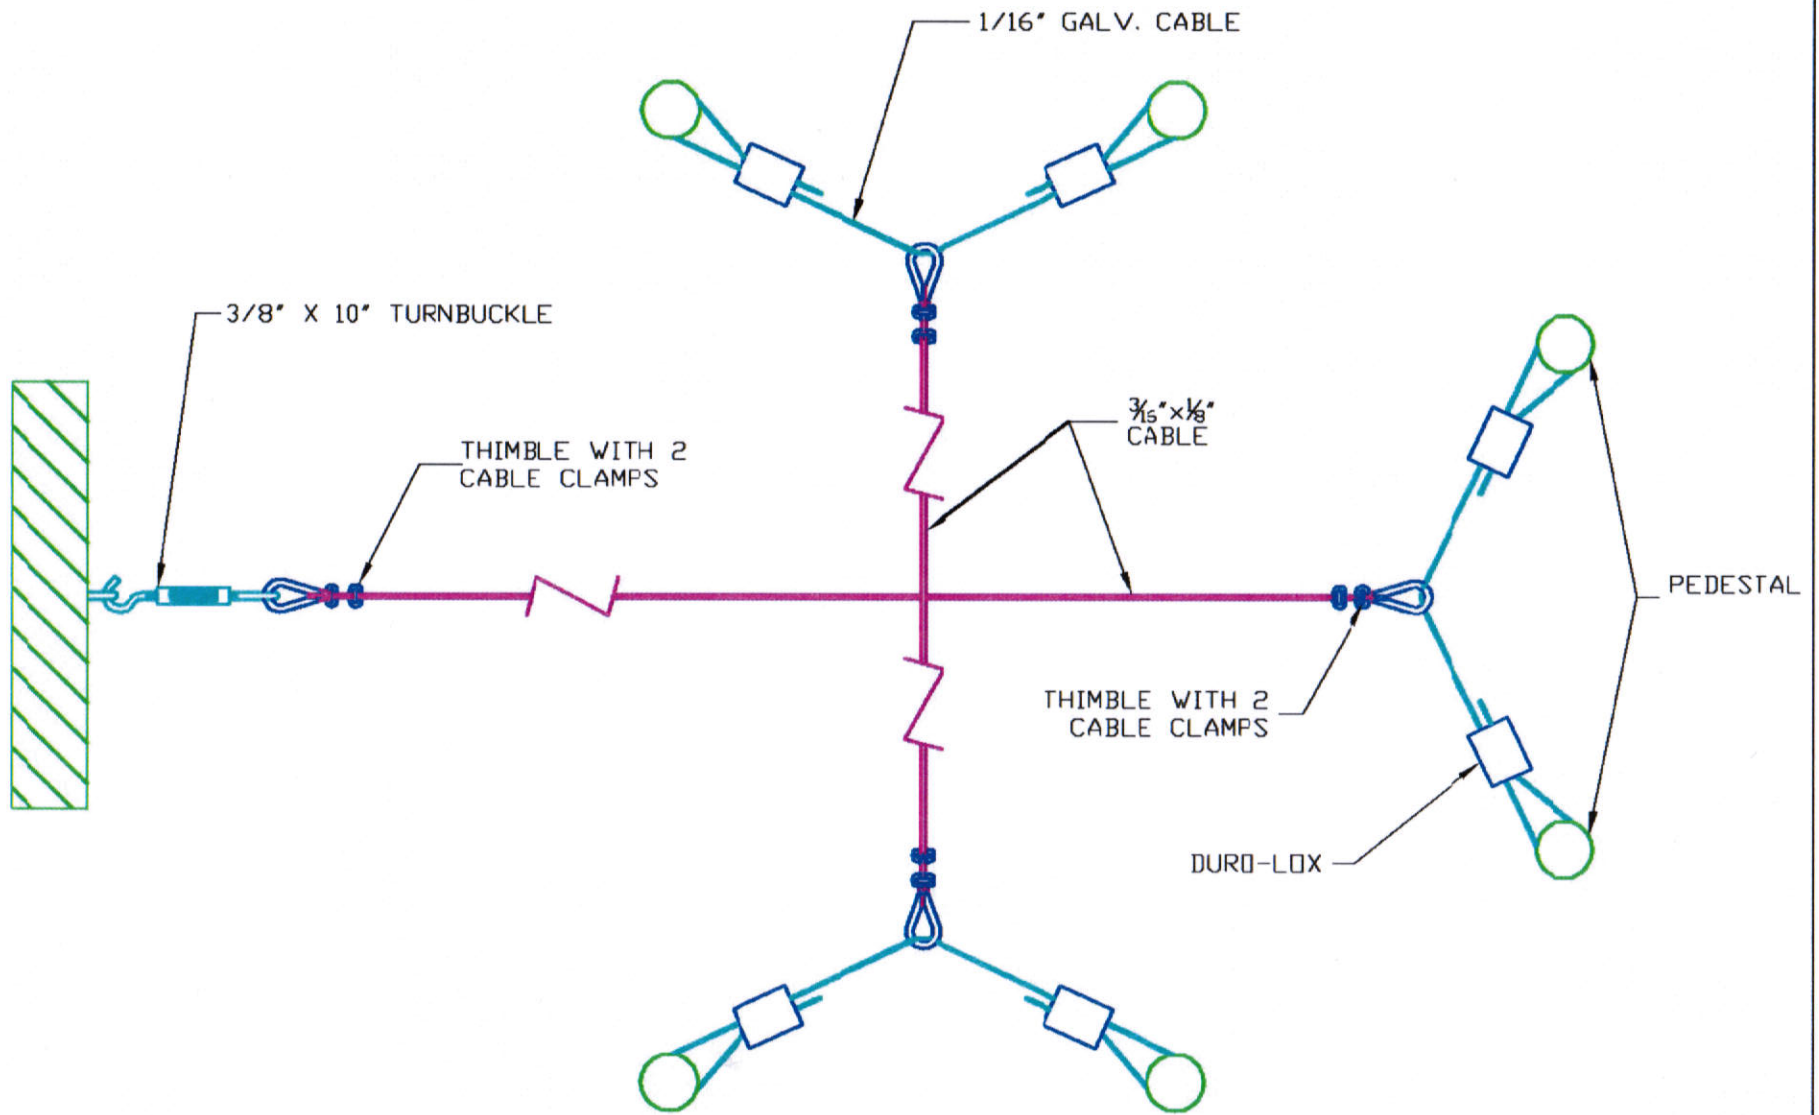

TEE JOINT DUCT - UNDER FLOOR MOUNTING  
 NO SCALE